


SOLAR PV ROOFTOP MAIN EQUIPMENT 324 kW

BRAND/MODEL	DESCRIPTION	Q'TY
Schutten STP6-300/72	SOLAR PANEL 300 W	1080
SMA STP50-40	Grid Connected Inverter 50 kW	6

RELAY PROTECTION TABLE

RELAY CODE	DESCRIPTION	COMMAND
27/59	Under/Over Voltage Relay	Trip CB-A
50/51 50N/51N	Phase and Ground Overcurrent Relay	Trip CB-A, CB-B
67/67N	Phase and Ground Directional Overcurrent Relay	Trip CB-A
81	Frequency Relay	Trip CB-A
32	Reversr Power Relay	Trip CB-B

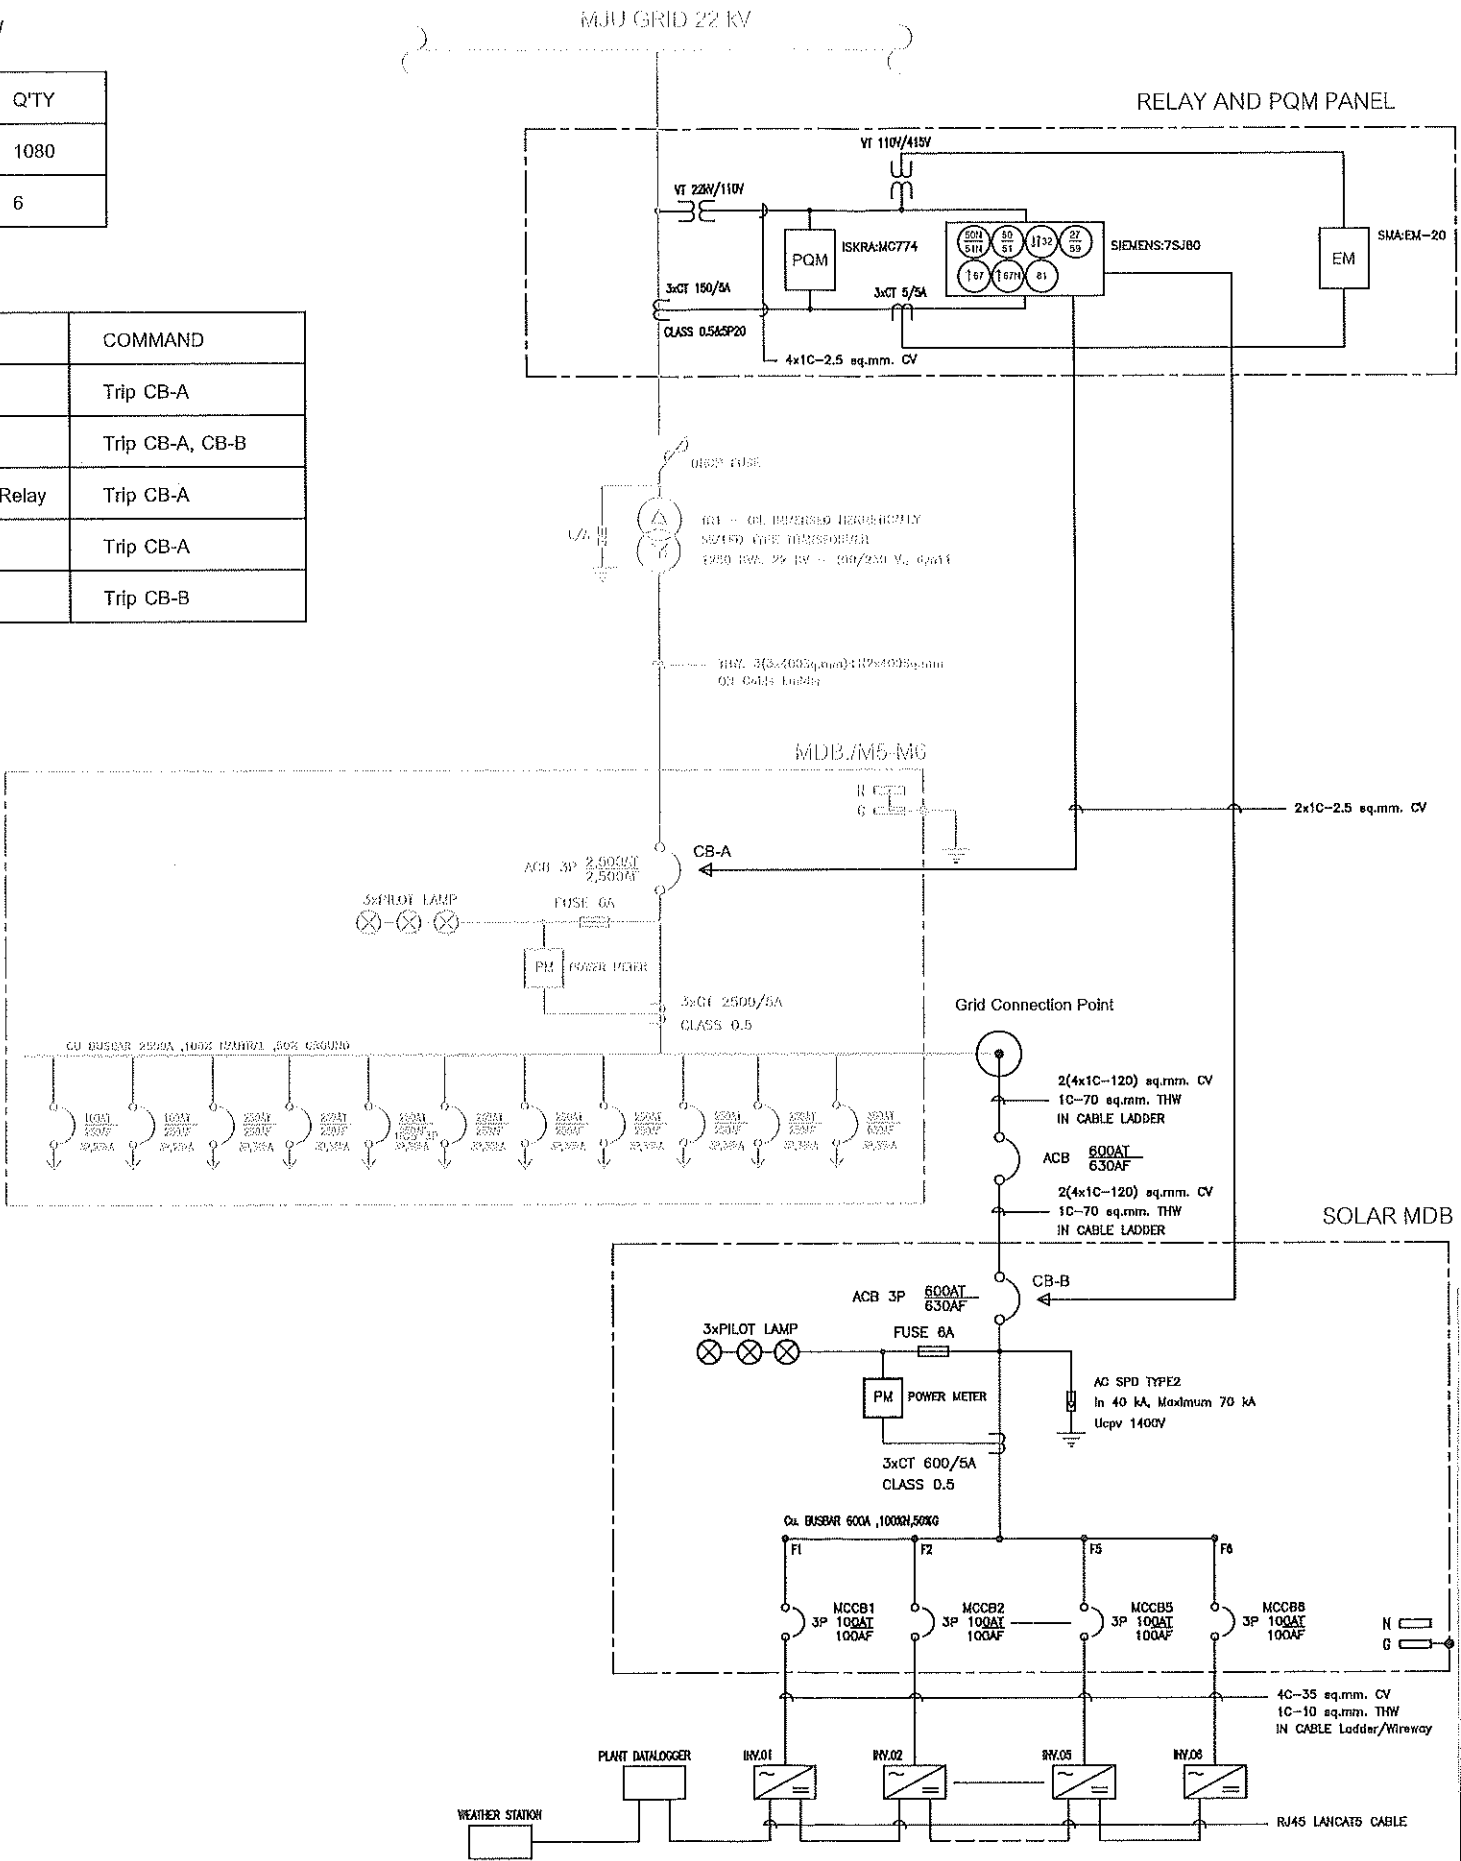

REVISIONS		
NO.	DESCRIPTION	DATE

CLIENT :

PROJET NAME :
Maejo University 300 kW

LOCATION :
Nong Han, San Sai, Chiang Mai 50290

DRAWING TITLE :

ผู้รับรองแบบ		
ลำดับ	ลายเซ็น	
1		นายวิทยา ฉางแก้ว วิศวกรไฟฟ้า ปฏิบัติการ
2		หัวหน้างานไฟฟ้า และอนุรักษ์ พลังงาน
3		ผอ.กองสวัสดิการ
4		รองอธิการบดี
5		อธิการบดี

DRAWN BY :

APPROVED BY :

SCALE : DRAWING NO :

REV.NO :

DATE : TOTAL :